

CANopen

Network configuration

Integration of Bürkert devices in CANopen networks

Operating instructions
Software

Content

CANopen quick guide	4
I. Setting the "CANopen" bus mode on the device	4
II. Setting baud rate and node ID	4
III. Setting Heartbeat/Nodeguarding	5
IV. Switching the device to operational	5
V. Display of the device state	6
VI. Bürkert color definitions	6
1. Introduction	8
2. Start-up	8
2.1 Node ID	8
2.2 Baud rate	8
2.3 Layer Setting Services (LSS)	9
3. Transmission services	12
3.1 Service Data Object (SDO)	12
3.2 Process Data Object (PDO)	12
3.3 Synchronization Object (SYNC)	13
3.4 Emergency Object (EMCY)	13
3.5 Nodeguarding	14
3.6 Heartbeat	14
3.7 Network Management Services (NMT)	14
3.8 Predefined Connection Set	15
4. Object overview	16
4.1 Detailed description	17
Object 0x1000 Device Type	17
Object 0x1001 Error Register	17
Object 0x1005 COB ID SYNC	17
Object 0x1006 Communication Cycle Period	17
Object 0x1008 Manufacturer Device Name	17

Object 0x1009	Manufacturer Hardware Version	17
Object 0x100A	Manufacturer Software Version	18
Object 0x100C	Guard Time	18
Object 0x100D	Life Time Factor	18
Object 0x1014	COB ID EMCY	18
Object 0x1016	Consumer Heartbeat Time	18
Object 0x1017	Producer Heartbeat Time	18
Object 0x1018	Identity Object	18
Object 0x1280 – 0x12FF	Client SDO Parameter	19
Object 0x1400 – 0x15FF	Receive PDO Communication Parameter	19
Object 0x1600 – 0x17FF	Receive PDO Mapping Parameter	19
Object 0x1800 – 0x19FF	Transmit PDO Communication Parameter	20
Object 0x1A00 – 0x1BFF	Transmit PDO Mapping Parameter	20
Object 0x2000	Bürkert Device Description Object	21
Object 0x2001	Device Communication Object	21
Object 0x2002	User Configuration Object	22
Object 0x2003	Error Management Object	23
Object 0x2004	Device Status Object	23
Object 0x2101	Locating Function	24
Object 0x210A	Trigger Maintenance Function	24
Object 0x2120	LED Modi	25
Object 0x2121	Valve Mode Configuration	25
Object 0x2122	LED Extern Colour	26
Object 0x2500 – 0x253F	Sensor Value	26
Object 0x2540 – 0x257F	Control Value	26

CANopen quick guide

This chapter describes in brief the steps on how to connect a CANopen device and to start it up.

Detailed information can be found in the following full description.

I. Setting the "CANopen" bus mode on the device

To operate a Bürkert device in a CANopen network, the bus mode must be changed from the standard setting "büS" to "CANopen".

There are different options for the setting depending on the device:

- A. If devices have a DIP switch for switching over the bus mode, move the switch to CANopen. The description can be found in the respective operating instructions.
- B. If devices have a display, set the bus mode on the display.
To make the setting with the left navigation button, switch to the configuration area and select "General settings".
Setting in the menu: ➡ "Parameter" ➡ "büS" ➡ "Advanced" ➡ "Bus mode" ➡ "CANopen."
- C. If devices do not have a DIP switch or display, set the bus mode with the PC software Bürkert-Communicator.
To make the setting, select "General settings".
Setting in the menu: ➡ "Parameter" ➡ "büS" ➡ "Advanced" ➡ "Bus mode" ➡ "CANopen."

II. Setting baud rate and node ID

After selecting the bus mode "CANopen", the baud rate must be selected for the device and the node ID entered.

Important information:

- Each device in the network has its own unique node ID.
- The baud rate is identical for all devices in the network.

There are different options for the setting depending on the device:

- A. If devices have DIP switch, the setting of the baud rate and node ID is described in the respective operating instructions.
- B. If devices have a display, set the baud rate and node ID on the display.
To make the setting with the left navigation button, switch to the configuration area and select "General settings".

Setting in the menu: → "Parameter" → "bÜS" → "Advanced"
 → "Baud rate" → Select the baud rate.
 → "bÜS address" → Enter the node ID

Automatic assignment of the node ID: If the device still does not have a node ID and is started in bÜS mode, the node ID is assigned automatically. The node ID required for the next steps can be seen in the "bÜS address" menu.

- C. If devices do not have DIP switch or a display, set the baud rate and node ID with the PC software Bürkert-Communicator.

To make the setting in Bürkert-Communicator, select "General settings".

Setting in the menu: → "Parameter" → "bÜS" → "Advanced"
 → "Baud rate" → Select the baud rate.
 → "bÜS address" → Enter the node ID.

Automatic assignment of the node ID: If the device still does not have a node ID and is started in bÜS mode, the node ID is assigned automatically. The node ID required for the next steps can be seen in the "bÜS address" menu.

Note: The setting can also be made with the Layer Setting Service. The description can be found in the following chapter "2.3 Layer Setting Services (LSS)".

III. Setting Heartbeat/Nodeguarding

Bürkert devices transmit Heartbeat messages as standard.

The standard Heartbeat time is 500 ms. If the Heartbeat time is to be changed, it must be entered in ms as SDO in object 0x1017.

If devices support Nodeguarding, this can be used instead of Heartbeat. In the case of Nodeguarding configure the objects 0x100C and 0x100D.

IV. Switching the device to operational

To switch the device to operational mode, transmit the NMT command "Operational". This looks as follows:

Identifier	DLC	Byte 1	Byte 2
0x00	02	01	Node ID

Meaning of node ID: unique device address in the CANopen network.

V. Display of the device state

In NAMUR mode, the status LED lights up according to NAMUR NE 107, in the color specified for the device status. The device state depends on the event with the highest priority.

Device status in NAMUR mode:

Priority	Color	Description
1 – highest priority	red	Failure, error or fault
2	orange	Function check
3	yellow	Out of specification
4	blue	Maintenance required
5	green	Diagnostics active
6 – lowest priority	white	Diagnostics inactive

VI. Bürkert color definitions

A. Predefined colors

off	0x10000000
white	0x10000001
green	0x10000002
blue	0x10000003
yellow	0x10000004
orange	0x10000005
red	0x10000006

A. User defined colors

A RGB code can be set as 0x00BBBGRR, where BB=blue, GG=green and RR=red, each 0...255 (0x00...0xFF).

teal	0x00FFFF00
pink	0x00FF00FF

Note: Some devices only support 0 and 255 for the blue color.

1. Introduction

Bürkert CANopen devices comply with the CANopen standard according to the standards:

- CiA Draft Standard 301; Application Layer and Communication Profile
- CiA Draft Standard Proposal 305; Layer Setting Services (LSS) and protocols

2. Start-up

2.1 Node ID

In a CANopen network each device must have a unique node ID. The node ID is saved in the Device Communication Object (0x2001) in sub-index 0x02 and can also be changed here.

CANopen also offers the option of changing the node ID via the so-called Layer Setting Services (LSS) (see Layer Setting Services (LSS))

2.2 Baud rate

The baud rate describes the transmission rate in a CANopen network.

Bürkert devices support the following baud rates:

Baud rate	Index
1 mbit/s	0
500 kbit/s	2
250 kbit/s	3
125 kbit/s	4
reserved	5
50 kbit/s	6
20 kbit/s	7
10 kbit/s	8

The baud rate for Bürkert devices is 500 kbit/s as standard. It is saved, the same as the node ID, in the Device Communication Object (0x2001) however in sub-index 0x01.

As with the node ID, CANopen also offers the option of changing the baud rate via LSS (see Layer Setting Services (LSS)).

2.3 Layer Setting Services (LSS)

As already mentioned, two things are required to connect CANopen devices to a network:

- All devices must use the same baud rate
- The node ID of a device must be unique.

If the manual setting cannot be made on the device, it can be made via the Layer Setting Services (LSS).

First a connection must be established with the device, then the baud rate and the node ID can be set via a "Dialog".

The device must be activated with the special COB-ID (0x7E5), the device responds via the COB-ID (0x7E4). LSS messages are always 8 bytes long, all unused bytes are reserved and should be initialized with 0.

The responses of the device include either a success message or an error message. The error message consists of an error code, which represents the error, and an error extension which supplies specific information about the error.

Example of the configuration via LSS:

1. Switch devices into configuration mode using the "Switch Mode Global" service; this will switch all devices into the configuration mode:

Identifier	DLC	Data							
		0	1	2	3	4	5	6	7
0x7E5	8	0x04	0x01	reserved					

2. Transfer the new baud rate to the device using the "Configure Bit Timing" service:

Identifier	DLC	Data							
		0	1	2	3	4	5	6	7
0x7E5	8	0x13	Table	Index	reserved				

Meaning of table: Indicates which baud rate table is to be used.

Meaning of index: Indicates the index within the baud rate table.

0 is the baud rate table which is defined according to CiA DSP-305:

Index	Baud rate
0	1 mbit/s
2	500 kbit/s
3	250 kbit/s
4	125 kbit/s
5	100 kbit/s
6	50 kbit/s
7	20 kbit/s
8	10 kbit/s

The response of the device to Configure Bit Timing:

Identifier	DLC	Data							
		0	1	2	3	4	5	6	7
0x7E4	8	0x13	Error Code	Error Extension	reserved				

Meaning of error code: Error code:

- 0 = successfully run
- 1 = baud rate is not supported
- 2 – 254 = reserved
- 255 = special error code, see error extension

Meaning of error extension: manufacturer-specific error code (if error code = 255)

3. If the device responds without an error, the baud rate must now be activated using the "Activate Bit Timing" service:

Identifier	DLC	Data							
		0	1	2	3	4	5	6	7
0x7E5	8	0x15	Delay	reserved					

Meaning of delay: Relative time until the new baud rate switches on in ms

4. Transfer the new node ID to the device using the "Configure node ID" service:

Identifier	DLC	Data							
		0	1	2	3	4	5	6	7
0x7E5	8	0x11	Node ID	reserved					

Meaning of node ID: New node ID for the device (only values between 1 and 127)

The response of the device to "Configure node ID":

Identifier	DLC	Data							
		0	1	2	3	4	5	6	7
0x7E4	8	0x11	Error Code	Error Extension	reserved				

Error code: Error code: 0 = successfully run
 1 = node ID invalid
 2 – 254 = reserved
 255 = special error code, see error extension

Error extension: manufacturer-specific error code (if error code = 255)

5. Switch the devices into operation mode using the "Switch Mode Global" service:

Identifier	DLC	Data							
		0	1	2	3	4	5	6	7
0x7E5	8	0x04	0x00	reserved					

Note:

The baud rate and the node ID can be changed independently of each other or re-assigned.

- Changing baud rate: To do this, steps 1, 2, 3 and 5 must be run.
- Assign new node ID: To do this, steps 1, 4 and 5 must be run.

3. Transmission services

3.1 Service Data Object (SDO)

SDOs (Service Data Objects) are used to parameterize object directory entries. They are read and written with a CANopen telegram. As soon as a CANopen slave is preoperational, they can be processed.

Two CAN messages are required to transfer data. Firstly there is the "SDO request" for an SDO request and secondly the "SDO response" for an SDO response.

The two network nodes, which are involved in this process, are designated as "SDO Client" and as "SDO Server". The server provides the data via its object directory or accepts it. The client requests the data (reads) or transfers it (writes). The initiative for an SDO transfer always comes from the client.

As an SDO transfer is confirmed, each SDO request must be answered, even if the device can provide no relevant data or the request was faulty. This negative response is called "Abort" and includes a long "Abort code" in addition to the 4 bytes. The reason for the abort is explained in more detail in the "Abort Code" and the address of the object directory entry, which refers to the faulty SDO transfer, is indicated.

3.2 Process Data Object (PDO)

PDOs (Process Data Objects) provide a quick option for transporting process and real-time data. PDOs can only be sent when the CANopen slave is operational.

PDOs include the work values of a CANopen slave for the cyclical process operation. Each CANopen Slave can manage several PDOs. However, it is important that each available PDO has its own COB ID.

The data field of a PDO telegram can be between 1 and 8 bytes. Any information of the CANopen slave can be represented within the data field.

The contents of a PDO cannot be directly interpreted. In principle, the transmitter and the receiver can interpret the contents of the PDO. It is therefore adequate to identify a PDO via its COB ID only.

The PDO mapping describes which individual process variables in the data field of a PDOs are sent, how they are arranged and which data type and length they have. For this purpose, each defined PDO describes the contents and the meaning of the data field by means of the PDO mapping within the object directory. This occurs both on the transmitter and on the receiver side.

There are different transmission types for PDOs.

- Asynchronous PDOs: are event-controlled and represent the standard transmission type for PDOs. This means, if at least one of the mapped process variables of the PDO changes, the PDO is transmitted immediately.
- Synchronous PDOs: are only transmitted if they receive a synchronization message beforehand. The PDO is therefore transmitted synchronously into the entire network. It is important that the input of all devices must be scanned according to the synchronization object. This gives a standard snapshot of the process results. When the next synchronization message occurs, the recorded data is transmitted with the synchronous PDOs. This results in a delay according to the cycle time of the synchronization message, as the consumers receive the process variables at the time of the previous synchronization message.

Also, so-called multiplexed PDOs are used for Bürkert devices.

- Multiplexed PDOs: offer the possibility of sending more than 8 bytes of data with an identifier. This is then used in Bürkert devices if 4 PDOs are inadequate to send all process values. In this case the remaining process values are mapped onto PDO 4. This functions by means of scanner MPDOs. A maximum of one of these scanner PDOs is allowed for each device. The manufacturer uses a so-called Object Scanner List to know which objects he must send. Scanner PDO (Source Address Mode (SAM)):

COB-ID	Node ID of producer	Index & sub-index	Data (max. 32 bits)
--------	---------------------	-------------------	---------------------

The sub-index is now changed for each object from the Object Scanner List and the new data is sent with the same MPDO. The advantage of this is that only one identifier is required for the MPDO in comparison with the use of normal PDOs.

3.3 Synchronization Object (SYNC)

The SYNC telegram is a periodical broadcast telegram and is a trigger for CANopen functions. The SYNC telegram can be used to transfer synchronized input data and simultaneously activate output data on a system-wide basis.

3.4 Emergency Object (EMCY)

If a CANopen Slave malfunctions, it sends an emergency message to the fieldbus. Only one emergency message is sent for each error. Neither is it specified how many consumers must receive the emergency message. If the nodes receive an emergency message, they may perform e.g. an emergency stop.

3.5 Nodeguarding

With Nodeguarding, the Master monitors the CANopen Slaves by sending cyclical telegrams to each Slave. Each CANopen Slave must reply to the Nodeguarding telegram with a Status telegram.

Nodeguarding enables the Master to detect the failure of a CANopen Slave.

3.6 Heartbeat

Heartbeat monitoring corresponds to Nodeguarding, in that the CANopen Master does not generate any request telegrams. The Heartbeat telegram is sent independently by the Slave ("Producer Heartbeat") and can be evaluated in the Master ("Consumer Heartbeat").

3.7 Network Management Services (NMT)

Each CANopen device may have different system statuses. These are activated by means of NMT commands.

When the device has been switched on ("Power On"), an internal system initialization ("initialization") is run. Following a successful initialization, a boot-up telegram responds. The device is now operational and is in the "preoperational" status. As a slave can be parameterized in this status, it is therefore possible to read and write SDOs, however the PDOs are not replaced.

The NMT command "Operational" can be used to switch a CANopen device to the operational status. In this status the process data is active, the RPDO and TPDO communication is running.

The NMT command "Reset Application" is used to restart the CANopen device, whereas the NMT command "Reset Communication" is used to reset the CANopen communication of the device only. Following both resets, the device is in the initialization status.

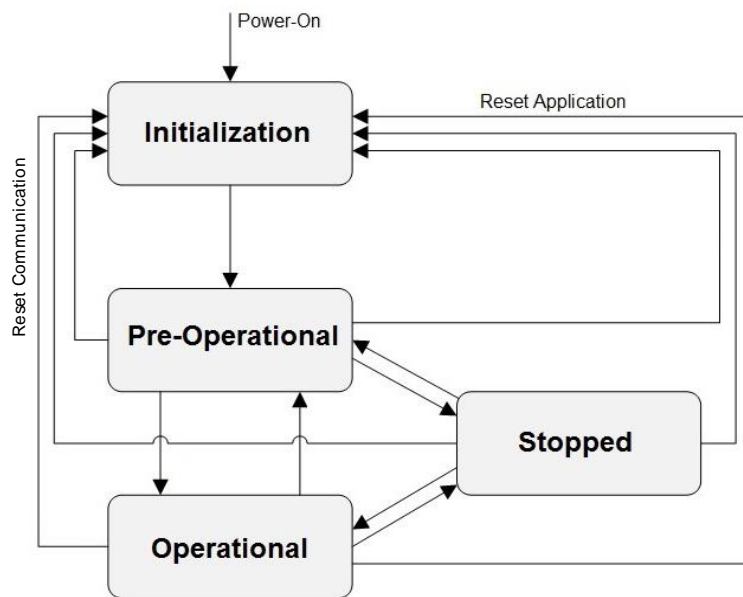


Figure 1: NMT (<http://doc.ingeniamc.com/emcl2/command-reference-manual/communications/canopen-protocol/canopen-objects/nmt/nmt-state-machine>), amended

3.8 Predefined Connection Set

To streamline the configuration effort with simple network structures, CANopen provides predefined identifiers, the so-called Predefined Connection Set:

Transmission service	COB ID(s)	Device
NMT	0x00	Receive only
SYNC	0x80	Receive only
EMCY	0x80 + node ID	Send
PDO	0x180 + node ID 0x200 + node ID 0x280 + node ID 0x300 + node ID 0x380 + node ID 0x400 + node ID 0x480 + node ID 0x500 + node ID	1. TPDO 1. RPDO 2. TPDO 2. RPDO 3. TPDO 3. RPDO 4. TPDO 4. RPDO
SDO	0x580 + node ID 0x600 + node ID	Send Receive
Nodeguarding/Heartbeat	0x700 + node ID	Send
LSS	0x7E4 0x7E5	Send Receive

4. Object overview

The following objects are supported as standard by a Bürkert CANopen device. Depending on the device type, not all of these objects are always supported.

Index (hex)	Sub-indices (hex)	Name	Access			PDO-map-pable
			read	write	constant	
1000	0	Device Type	x			
1001	0	Error Register	x			
1005	0	COB ID SYNC	x	x		
1006	0	Communication Cycle Period	x	x		
1008	0	Manufacturer Device Name			x	
1009	0	Manufacturer Hardware Version			x	
100A	0	Manufacturer Software Version			x	
100C	0	Guard Time	x	x		
100D	0	Life Time Factor	x	x		
1014	0	COB ID EMCY	x			
1016	0 – 7F	Consumer Heartbeat Time	x	x		
1017	0	Producer Heartbeat Time	x	x		
1018	0 – 4	Identity Object	x			
1200 – 127F	0 – 3	Server SDO Parameter	x	(x)		
1280 – 12FF	0 – 3	Client SDO Parameter	x	x		
1400 – 15FF	0 – 2	Receive PDO Communication Parameter	x	(x)		
1600 – 17FF	0 – 40	Receive PDO Mapping Parameter	x	x		
1800 – 19FF	0 – 5	Transmit PDO Communication Parameter	x	(x)		
1A00 – 1BFF	0 – 40	Transmit PDO Mapping Parameter	x	x		
2000	0 – 9	Bürkert Device Description Object	x			
2001	0 – D	Device Communication Object	x	(x)		
2002	0 – 4	User Configuration Object	x	x		
2003	0 – 4	Error Management Object	x	(x)		

x - the characteristic applies

(x) - the characteristic may apply depending on sub-index

Index (hex)	Sub-indices (hex)	Name	Access			PDO- map- pable
			read	write	constant	
2004	0 – 13	Device Status Object	x	(x)		(x)
2101	0 – 1	Locating Function	x	(x)		
210A	0 – 1	Trigger Maintenance Function	x	(x)		
2120	0	LED Modi	x	x		
2121	0 – 3	Valve Mode Configuration	x	(x)		
2122	0	LED Extern Color	x	x		
2500 – 253F	0 – 6	Sensor Value	x	(x)		(x)
2540 – 257F	0 – 6	Control Value	x	(x)		(x)

x - the characteristic applies

(x) - the characteristic may apply depending on sub-index

4.1 Detailed description

Object 0x1000 Device Type

Describes device type and applied profile

Data type: Unsigned32

Object 0x1001 Error Register

Register for device errors; part of the Emergency object

Data type: Unsigned8

Object 0x1005 COB ID SYNC

Specifies the COB ID for the SYNC object and the generation of SYNC telegrams

Data type: Unsigned32

Default: 0x00000080

Object 0x1006 Communication Cycle Period

The interval between successive SYNC signals in μ sec

Data type: Unsigned32

Object 0x1008 Manufacturer Device Name

Device designation of the manufacturer

Data type: Visible_String

Object 0x1009 Manufacturer Hardware Version

Version description of the hardware

Data type: Visible_String

Object 0x100A Manufacturer Software Version

Version description of the software

Data type: Visible_String

Object 0x100C Guard Time

Setting of the Nodeguarding time in msec

Data type: Unsigned16

Object 0x100D Life Time Factor

Setting of a factor according to which the slave must have responded to the Nodeguarding telegram

Data type: Unsigned8

Object 0x1014 COB ID EMCY

Specifies the COB ID for the Emergency object

Data type: Unsigned32

Default: 0x80 + node ID

Object 0x1016 Consumer Heartbeat Time

Sub-Index	Name	Data type	Default	Access	
				Read	Write
0x00	Number Of Entries	Unsigned8	127	x	
0x01	Consumer Heartbeat Time	Unsigned32	0	x	x
0x02	Consumer Heartbeat Time_2	Unsigned32	0	x	x
...
0x7F	Consumer Heartbeat Time_7F	Unsigned32	0	x	x

This is where the Heartbeat times are entered which the Master consumes. Up to 127 devices are possible.

Object 0x1017 Producer Heartbeat Time

Setting of the Heartbeat time in msec

Data type: Unsigned16

Default: 500

Object 0x1018 Identity Object

Sub-Index	Name	Data type	Default	Access	
				Read	Write
0x00	Number Of Entries	Unsigned8	4	x	
0x01	Vendor ID	Unsigned32	0x39	x	
0x02	Product Code	Unsigned32		x	
0x03	Revision Number	Unsigned32		x	
0x04	Serial Number	Unsigned32		x	

Object 0x1200 – 0x127F**Server SDO Parameter**

Sub-Index	Name	Data type	Default	Access	
				Read	Write
0x00	Number Of Entries	Unsigned8	3	x	
0x01	COB ID Client To Server	Unsigned32	0x600 + node ID	x	(x)
0x02	COB ID Server To Client	Unsigned32	0x580 + node ID	x	(x)
0x03	Node ID of the SDO Client	Unsigned8		x	x

(x) – applies conditionally, depending on whether it is the first server SDO parameter or not. There is one object in the object directory for each available server SDO parameter. These objects receive a continuous index, from 0x1200 to maximum 0x127F.

Object 0x1280 – 0x12FF**Client SDO Parameter**

Sub-Index	Name	Data type	Default	Access	
				Read	Write
0x00	Number Of Entries	Unsigned8	3	x	
0x01	COB ID Client To Server	Unsigned32	0x600 + node ID	x	x
0x02	COB ID Server To Client	Unsigned32	0x580 + node ID	x	x
0x03	Node ID of the SDO Server	Unsigned8		x	x

Object 0x1400 – 0x15FF**Receive PDO Communication Parameter**

Sub-Index	Name	Data type	Default	Access	
				Read	Write
0x00	Number Of Entries	Unsigned8	2	x	
0x01	COB ID	Unsigned32	0x200 + node ID	x	x
0x02	Transmission Type	Unsigned8	0xFE	x	x

There is one object in the object directory for each available Receive PDO Communication parameter. These objects receive a continuous index, from 0x1400 to maximum 0x15FF. The COB ID is increased by 0x100 for each entry.

Object 0x1600 – 0x17FF**Receive PDO Mapping Parameter**

Sub-Index	Name	Data type	Default	Access	
				Read	Write
0x00	Number Of Entries	Unsigned8		x	x
0x01	PDO Mapping Entry	Unsigned32		x	x
0x02	PDO Mapping Entry_2	Unsigned32		x	x
...
0x08	PDO Mapping Entry_8	Unsigned32		x	x

There is one object in the object directory for each available Receive PDO Mapping parameter. These objects receive a continuous index, from 0x1600 to maximum 0x17FF. These Mapping parameters may have up to 8 mapping entries, each of which is in a sub-index.

Object 0x1800 – 0x19FF Transmit PDO Communication Parameter

Sub-Index	Name	Data type	Default	Access	
				Read	Write
0x00	Number Of Entries	Unsigned8	5	x	
0x01	COB ID	Unsigned32	0x180 + node ID	x	x
0x02	Transmission Type	Unsigned8	0xFE	x	x
0x03	Inhibit Time	Unsigned16	5000	x	x
0x04	Compatibility Entry	Unsigned8		x	
0x05	Event Timer	Unsigned16	1000	x	x

There is one object in the object directory for each available Transmit PDO Communication parameter. These objects receive a continuous index, from 0x1800 to maximum 0x19FF. The COB ID is increased by 0x100 for each entry.

Object 0x1A00 – 0x1BFF Transmit PDO Mapping Parameter

Sub-Index	Name	Data type	Default	Access	
				Read	Write
0x00	Number Of Entries	Unsigned8		x	x
0x01	PDO Mapping Entry	Unsigned32		x	x
0x02	PDO Mapping Entry	Unsigned32		x	x
...
0x08	PDO mapping Entry_8	Unsigned32		x	x

There is one object in the object directory for each available Transmit PDO Mapping parameter. These objects receive a continuous index, from 0x1A00 to maximum 0x1BFF. These Mapping parameters may have up to 8 mapping entries, each of which is in a sub-index.

Object 0x2000 **Bürkert Device Description Object**

Sub-Index	Name	Data type	Default	Access	
				Read	Write
0x00	Number Of Entries	Unsigned8	9	x	
0x01	Device Name	Visible_String		x	
0x02	Ident Number	Unsigned32		x	
0x03	Manufacture Date	Visible_String		x	
0x04	Software Ident Number	Unsigned32		x	
0x05	Software version	Unsigned32		x	
0x06	Hardware version	Unsigned32		x	
0x07	Serial Number	Unsigned32		x	
0x08	Product Code	Unsigned32		x	
0x09	Product Group	Unsigned8		x	

Description of the sub-indices:

Device Name:	Unique device name
Ident Number:	Unique ident number of the device
Manufacture Date:	Date of manufacture of the device
Software Ident Number:	Unique ident number of the software
Software version:	Version number of the software
Hardware version:	Version number of the hardware
Serial Number:	Unique serial number
Product Code:	Unique product code
Product Group:	Product group of the device

Object 0x2001 **Device Communication Object**

Sub-Index	Name	Data type	Default	Access	
				Read	Write
0x00	Number Of Entries	Unsigned8	13	x	
0x01	Baud rate	Unsigned8	2	x	x
0x02	Address	Unsigned8		x	x
0x03	büS Mode	Unsigned8	1	x	x
0x04	Reset	Unsigned8	0	x	x
0x05	büS Version	Unsigned32		x	
0x06	Rx error count	Unsigned8		x	
0x07	Rx error count max	Unsigned8		x	x
0x08	Tx error count	Unsigned8		x	
0x09	Tx error count max	Unsigned8		x	x

0x0A	CAN operation status	Unsigned8		x	
0x0B	Termination resistor	Unsigned8		x	
0x0D	EDS Version	Unsigned8		x	

Description of the sub-indices:

Baud rate:	Baud rate of the device
Address:	Use "Static Node ID" of object 0x2002 (if supported by the device)
büS Mode:	Selection between CANopen and büS mode 0 = CANopen 1 = büS
Reset:	Possibility of communication reset or device reset 0 = no reset 1 = communication reset 2 = device reset
büS Version:	Version number of the büS
Rx error count:	Counter for Rx error
Rx error count max:	Maximum Rx number of errors
Tx error count:	Counter for Tx error
Tx error count max:	Maximum Tx number of errors
CAN operation status:	Display of the CAN Operation Status 4 = stopped 5 = operational 127 = pre-operational
Termination resistor:	Switch internal terminating resistor 0 = Inactive 1 = Active
EDS Version:	EDS version used by the device software Byte 0: Revision Byte 1: Version Example: 50 or 0x32 → EDS version 3.2

Object 0x2002 User Configuration Object

Sub-Index	Name	Data type	Default	Access	
				Read	Write
0x00	Number Of Entries	Unsigned8	4	x	
0x02	Location Information	Visible_String		x	x
0x03	User Description	Visible_String		x	x
0x04	Displayed Device Name	Visible_String		x	X
0x05	Static Node ID	Unsigned8	0	x	x

Description of the sub-indices:

Location Information:	Description of the physical device location
User Description:	Description of the device
Displayed Device Name:	Displayed device name (device name in the Bürkert display unit)
Static Node ID:	Node ID of the device

Object 0x2003 Error Management Object

Sub-Index	Name	Data type	De- fault	Access		PDO mappa- ble
				Read	Write	
0x00	Number Of Entries	Unsigned8	4	x		
0x04	Logbook Download	domain		x		

Description of the sub-indices:

Logbook Download: Log in XML format

Object 0x2004 Device Status Object

Sub-Index	Name	Data type	De- fault	Access		PDO mappa- ble
				Read	Write	
0x00	Number Of Entries	Unsigned8	17	x		
0x01	Device Status NamurNe107	Unsigned8	0	x		x
0x02	Device Temperature	Real32		x		
0x03	Device Supply Voltage	Real32		x		
0x04	Operation Time_[s]	Unsigned32		x		
0x05	Maximum Device Temperature	Unsigned16		x		
0x06	Minimum Device Temperature	Unsigned16		x		
0x07	Maximum Device Voltage	Real32		x		
0x08	Minimum Device Voltage	Real32		x		
0x0A	Device Current	Real32		x		
0x0B	Maximum Device Current	Real32		x		
0x0C	Minimum Device Current	Real32		x		
0x0D	Device Boot Counter	Unsigned32		x		
0x0E	Trans Mem Status	Unsigned8		x	x	
0x10	Battery Voltage	Real32		x		
0x11	Voltage Drop Counter	Unsigned32		x		
0x12	Operation Time Since Last Boot	Unsigned32	0	x		
0x13	Actuator Supply Voltage	Real32		x		

Description of the sub-indices:

Device Status NamurNe107: Namur status of the device

For exact description, see [Chapter V page 6](#)

Device Temperature: Device temperature in [K]

Device Supply Voltage:	Supply voltage of the device in [K]
Operation Time_[s]:	Time, which the device is operating in [s]
Maximum Device Temperature:	Highest ever-measured temperature in [K]
Minimum Device Temperature:	Lowest ever measured temperature in [K]
Maximum Device Voltage:	Highest supply voltage measured during running time in [V]
Minimum Device Voltage:	Lowest supply voltage measured during running time in [V]
Device Current:	Current consumption of the device in [A]
Maximum Device Current:	Highest ever-measured current consumption in [A]
Minimum Device Current:	Lowest ever measured current consumption in [A]
Device Boot Counter:	Device boot counter
Trans Mem Status:	Transferable memory status 0 = Unknown status 1 = Memory available 2 = Memory not available 3 = Memory not available 4 = Memory optional 5 = Memory in progress 6 = Client searching for provider 7 = Client is managed by a provider 8 = Changes available 9 = Provider search turned off 10 = Client is waiting for provider 11 = Client has been reconfigured
Battery Voltage:	Battery voltage in [V]
Voltage Drop Counter:	Count of voltage drops since last device restart
Operation Time Since Last Boot:	Operating duration since last boot in [s]
Actuator Supply Voltage:	Supply voltage of the actuator in [V]

Object 0x2101 Locating Function

Sub Index	Name	Data type	Default	Access		PDO-mappable
				Read	Write	
0x00	Number Of Entries	Unsigned8	1	x		
0x01	Call/Cancel	Unsigned8	0	x	x	

Description of the sub-indices:

Call/Cancel: 1 = Start the locating function
 0 = Stop the locating function

Device LED flashes several times approx.10 seconds after starting the function. Before the function can be triggered again, it must first be stopped (set Call/Cancel to 0).

Object 0x210A Trigger Maintenance Function

Sub Index	Name	Data typ	Default	Access		PDO-mappable
				Read	Write	
0x00	Number Of Entries	Unsigned8	1	x		
0x01	Call/Cancel	Unsigned8	0	x	x	

Description of the sub-indices:

Call/Cancel: 1 = Start the trigger maintenance function
0 = Stop the trigger maintenance function

Device is set into maintenance state after starting the functionality. The device LED is blue in maintenance state.

Attention: If an event with higher priority is active, the maintenance status is not displayed on the device status. For a detailed description of the device status, see [Chapter V on page 6](#).

Object 0x2120**LED Modi**

Behavior of the device status LED

Data type: Unsigned 32

Default: 0

0	NAMUR mode	Color depends on status of device according to NAMUR NE107
2	Valve mode	Settings from objects 0x2121 will be used (only for valves)
3	Valve mode + warnings	Settings from object 0x2121 will be used (only for valves)
4	Fixed color	Setting from object 0x2122 will be used
6	LED off	LED is always off

Object 0x2121**Valve Mode Configuration**

Sub Index	Name	Data typ	Default	Access		PDO-mappable
				Read	Write	
0x00	Number Of Entries	Unsigned8	3	x		
0x01	Colour Position Closed	Unsigned32	0x10000002	x	x	
0x02	Colour Position between	Unsigned32	0x10000000	x	x	
0x03	Colour Position Open	Unsigned32	0x10000004	x	x	

Color settings for the device status LED in valve mode (object 0x2120 value set to 2 or 3), see [Chapter VI on page 6](#).

Note: Only for valves with 3 positions, valves with more positions may use a device-specific object.

Description of the sub-indices:

Colour position Closed: color of the device status LED when the valve is closed
 Colour Position between: color of the device status LED when the valve is in between
 Colour Position Open: color of the device status LED when the valve is open

Object 0x2122 LED Extern Colour

Fixed color setting for the device status LED in fixed color mode (object 0x2120 value set to 4) see [Chapter VI on page 6](#).

Data type: Unsigned32

Default: 0x10000001

Object 0x2500 – 0x253F Sensor Value

Sub-Index	Name	Data type	Default	Access		PDO-mappable
				Read	Write	
0x00	Number Of Entries	Unsigned8	6	x		
0x01	Value			x	x	x
0x06	Precision	Real32		x		

Description of the sub-indices:

Value: Value, which can be mapped onto a TPDO

Precision: Accuracy of the value

The sensor value is the process value of a Bürkert device. There is one entry in the object directory for each available sensor value. These objects receive a continuous index, from 0x2500 to maximum 0x253F.

The value objects of a sensor value can be mapped onto the TPDOs and therefore be consumed by other devices in the network.

Object 0x2540 – 0x257F Control Value

Sub-Index	Name	Data type	Default	Access		PDO-mappable
				Read	Write	
0x00	Number Of Entries	Unsigned8	6	x		
0x01	Value			x	x	x
0x06	Precision	Real32		x		

Description of the sub-indices:

Value: Value, which can be mapped onto an RPDO

Precision: Accuracy of the value

The control value receives a value, e.g. from another device via a PDO or by a user entry. There is a continuous index, from 0x2540 to maximum 0x257F, for each available control value. The value objects can be mapped onto the RPDOs and therefore be consumed by other devices in the network.